

GENERAL NOTES :

1. ALL ELECTRICAL WORKS TO BE UNDERTAKEN SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE PHILIPPINE ELECTRICAL CODE PART 1 AND 2 AND THE RULES AND REGULATIONS OF LOCAL ENFORCING UTILITY POWER AND TELEPHONE COMPANY.

2. ALL MATERIALS AND EQUIPMENT TO BE USED SHALL BE BRAND NEW AND APPROVED TYPE FOR BOTH LOCATION AND PURPOSES.

3. THE ELECTRICAL WORKS SHALL BE UNDER THE IMMEDIATE SUPERVISION OF A DULY LICENSED ELECTRICAL ENGINEER OR MASTER ELECTRICIAN AUTHORIZED FOR EACH GRADE.

4. PROPER GROUNDING OR ELECTRICAL EQUIPMENT SHALL BE IN ACCORDANCE WITH THE PHILIPPINE ELECTRICAL CODE.

5. FIELD VERIFICATION SHALL BE DONE BY THE CONTRACTOR ANY DISCREPANCIES OR CHANGES SHALL BE PROMPTLY NOTIFIED TO THE OWNER'S REPRESENTATIVE OR DESIGNER.

6. ALL ELECTRICAL CONDUITS AND TELEPHONE SERVICE ENTRANCE THAT INSTALLED BELOW THE GROUND SHALL BE IN CONCRETE ENCASEMENT.

7. REFER TO SHEET E-1 FOR EXACT NUMBER AND LOCATION OF DEVICES/EQUIPMENT FOR ELECTRICAL SYSTEM. ANY CONFLICT ON QUANTITY AND/OR LAYOUT MUST BE VERIFIED AND CONFIRMED TO DESIGNER/CONSULTANT.

8. ANY DEVICES OR EQUIPMENT NOT REFLECTED OR SHOWN ON PLANS BUT REQUIRED TO COMPLETE THE SYSTEM MUST BE INCLUDED ON SCOPE OF WORK.

LEGEND AND SYMBOLS :

●	CONCRETE POLE
■	SERVICE ENTRANCE PEDESTAL
—	230 V SECONDARY LINE
— + — + — +	13.8 kV PRIMARY LINE
□	DISTRIBUTION TRANSFORMER
CP. 1	CONSTRUCTION POINT
⊕	TRUSS/DOWN GUY
⋈	LOAD BREAK SWITCH (NORMALLY CLOSED)


CONSTRUCTION POINTS

CP. 1

SUPPLY AND INSTALL -
2-13.5m primary concrete pole, class 3A, complete with pole dressing, pole grounding and accessories. 3-167 kVA, 13.8kV/230V Distribution Transformers, accessories, support brackets and 1 set of truss guy support. Include tapping to existing primary lines, energization, testing and commissioning.

CP. 2

SUPPLY AND INSTALL -
1 set of 250 sq. mm. THHN and 1-50 sq. meter THHN as ground wire (99.9% copper, fire retardant) secondary electrical from distribution transformers to existing concrete pedestal of three-storey building of CVMBS building. Include messenger wire and secondary line accessories.

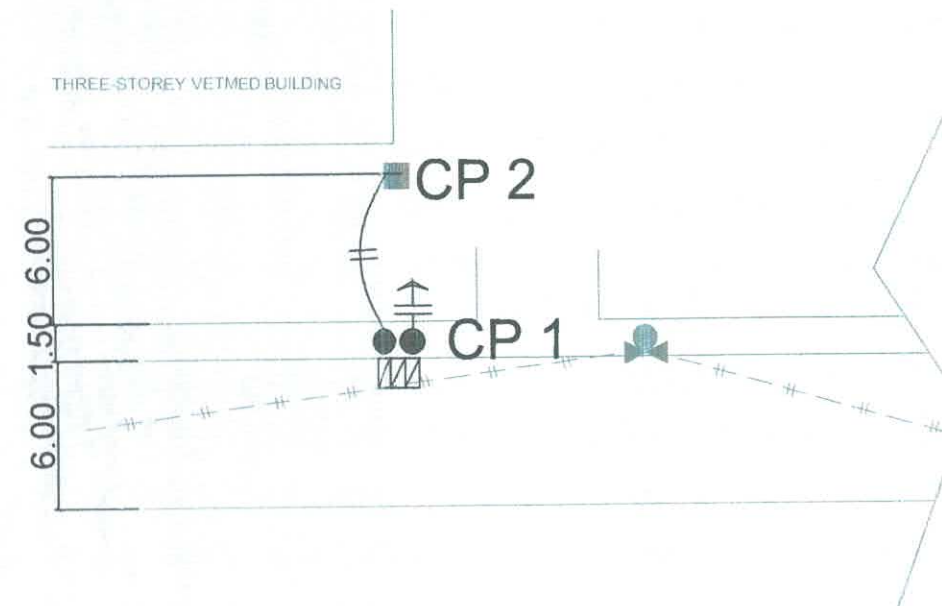

1
E 1
ELECTRICAL FEEDER LINE LAYOUT
SCALE 1 : 300 MTS

	PREPARED BY:	END USER:	REVIEWED BY:	ENDORSED BY:	REC. APPROVAL:		APPROVED BY:	PROJECT TITLE/ LOCATION:	IMPLEMENTING AGENCY:	SHT NO:
	R. J. R. SANCHEZ PDU CVPD	R. C. BAHIA DEAN CVMBS	BONNIE P. PENA PROF. ELECTL. ENGR.	S. B. BAYOT JR. HEAD FMO	O. B. DELOS REYES DIRECTOR PROJECT MANAGEMENT OFFICE	A. G. MAGDAWAS VPPD CVSU	J. X. B. NEPOMUCENO VPASS CVSU	M. A. P. NUESTRO PRESIDENT CVSU	UPGRADING OF ELECTRICAL SYSTEM OF VETMED COMPLEX AND ANIMAL SCIENCE BUILDING CAVITE STATE UNIVERSITY INDANG, CAVITE	CAVITE STATE UNIVERSITY